

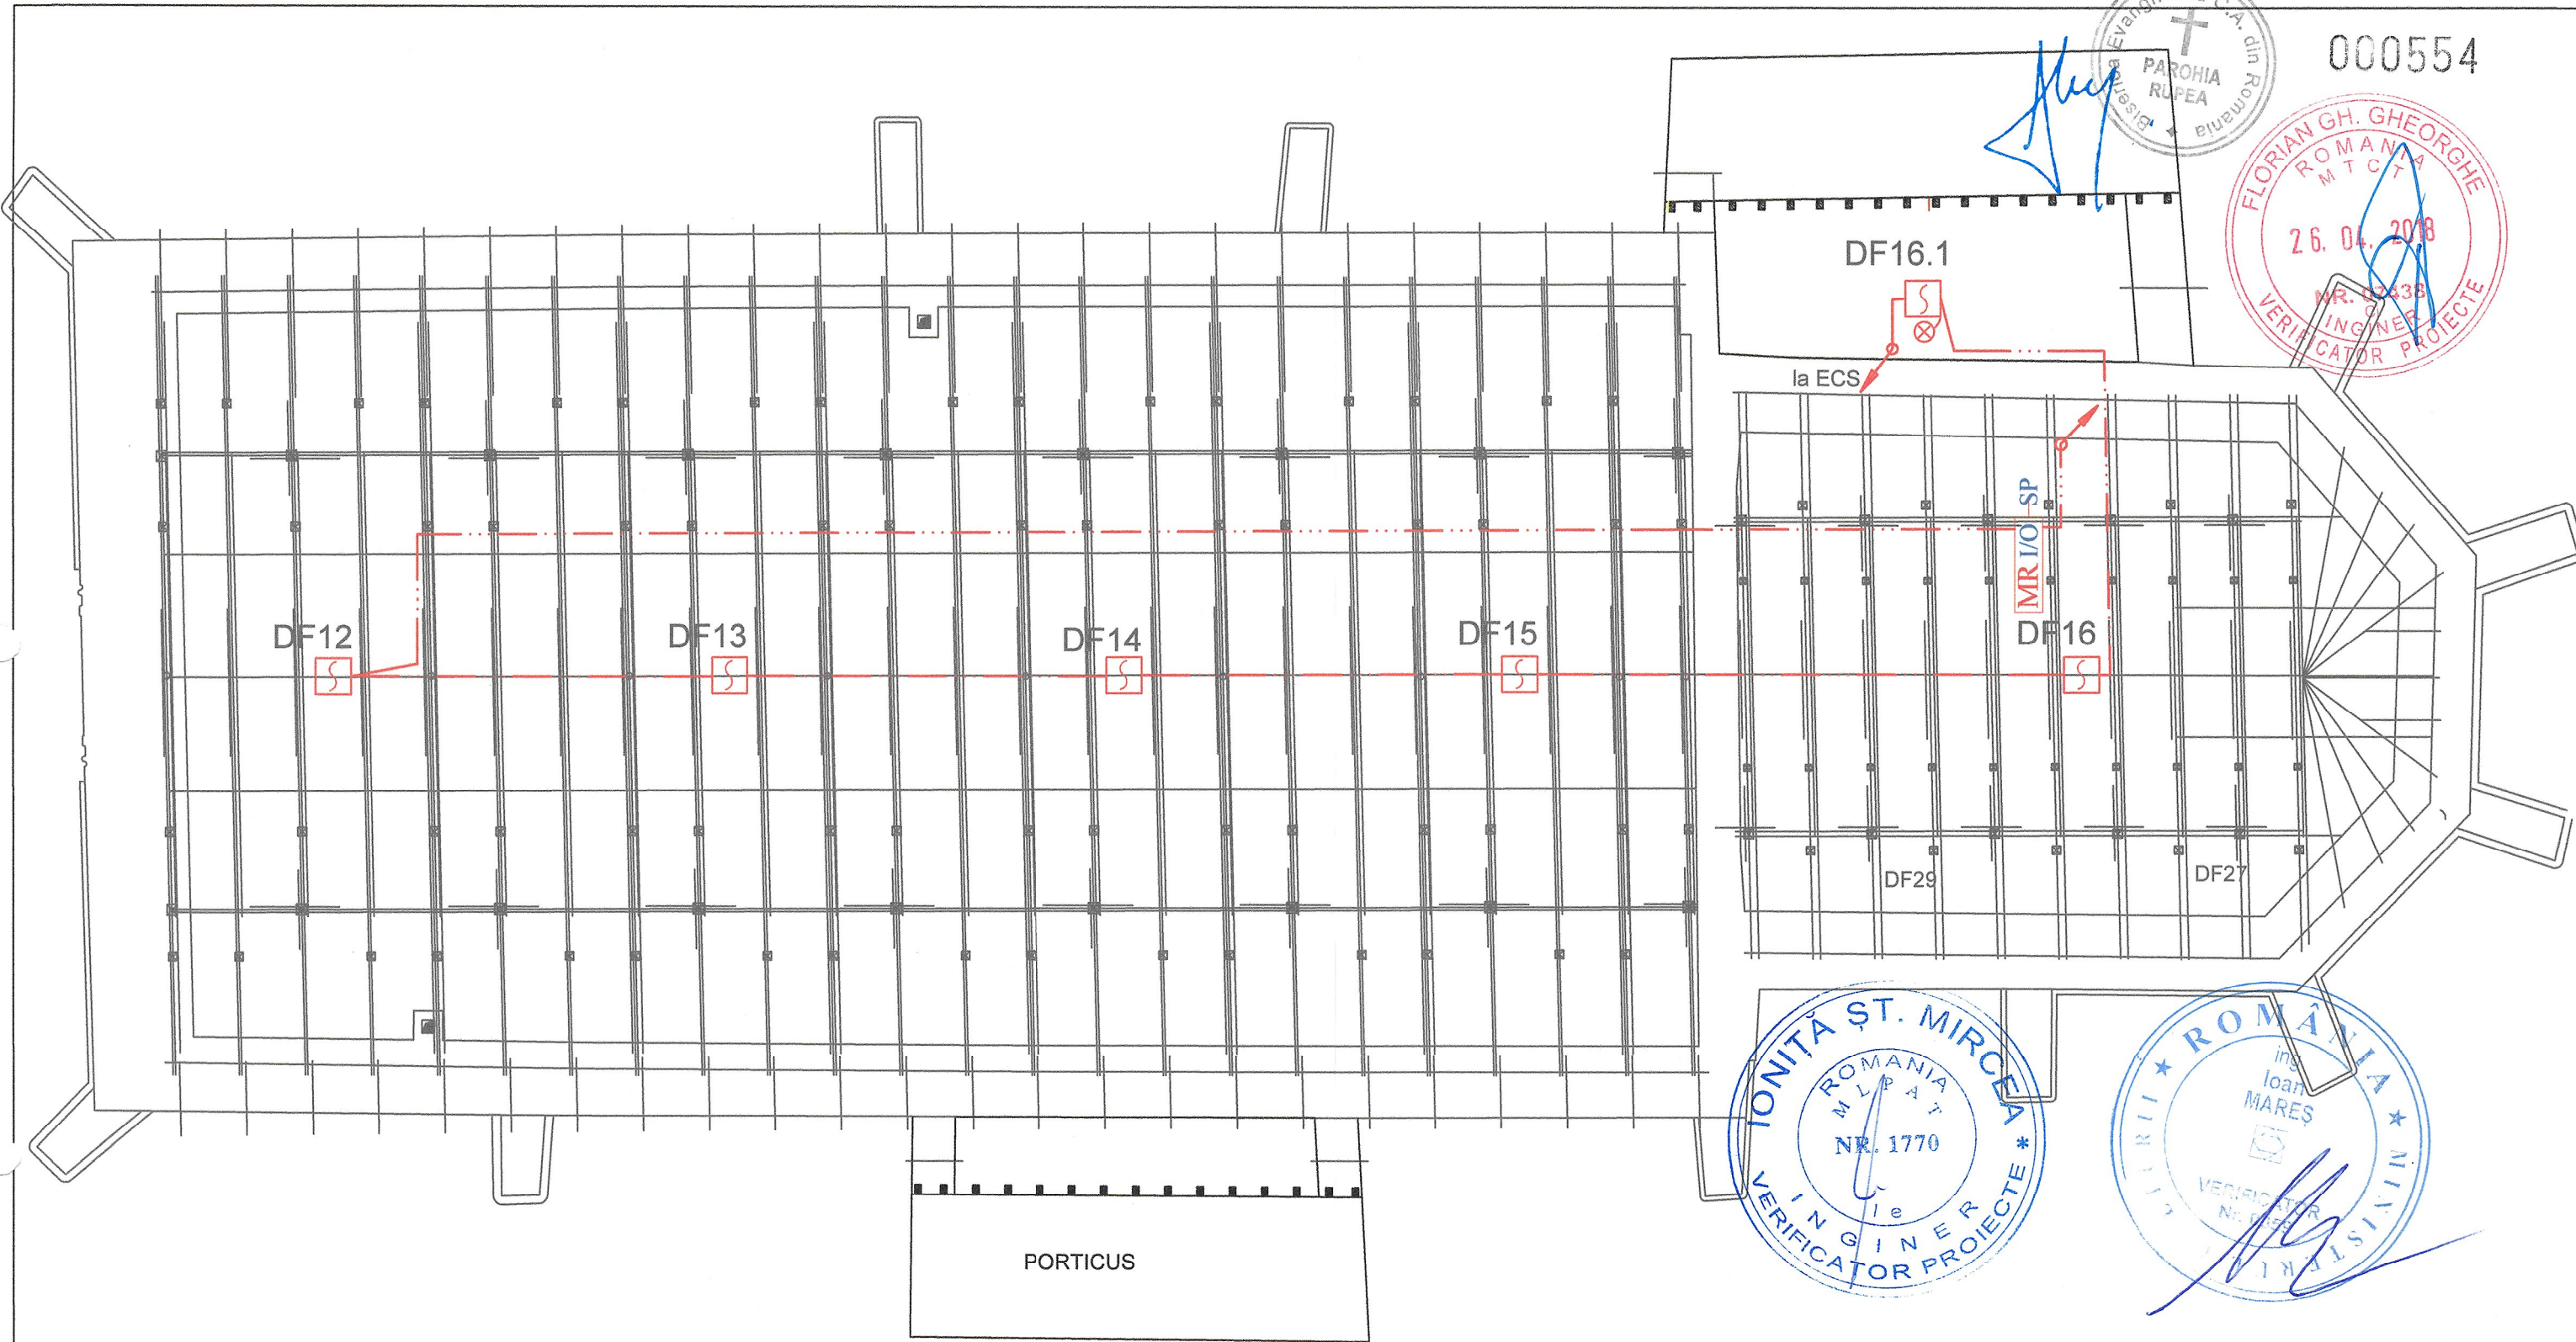


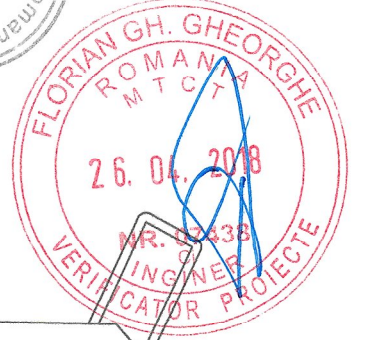


000554



LEGENDA:

-  Detector optic de fum, adresabil, cu izolator scurtcircuit inglobat
-  Modul I/O -adresabil, cu izolator scurtcircuit inglobat -actionare sistem de stingere cu praf
-  Detector optic de fum cu indicator paralel, adresabil, cu izolator scurtcircuit inglobat montat in pod sacristie

NOTA:
 Traseele cablurilor instalatiei de semnalizare a incendiilor se vor amplasa la distanta de minim 30cm fata de traseele instalatiei electrice de curenti tari.
 La executarea instalatiilor electrice si a instalatiilor de semnalizare a incendiilor se vor respecta prevederile din normativele P118/3-2015.si I7-2011

PROIECTANT GENERAL/ARHITECTURA : ALEXANDRU IOAN NICHIFOR - BIROU INDIVIDUAL DE ARHITECTURA

Verificator Expert	NUME:	SEMNATURA:	CERINTA:	REFERAT / EXPERTIZA NR./DATA:
PROIECTANT GENERAL: ALEXANDRU IOAN NICHIFOR B.I.A. Sgr. pr. 03/2017				
S.C. PROCONFORT S.R.L. Brasov str. Zizinului nr. 102* tel/fax: 0268 333311			Beneficiar: PAROHIA EVANGHELICA C.A. RUPEA	
SPECIFICATIE:	NUME:	SEMNATURA:	Scara:	Nr. pr. electrice: 1314/ 2017
Sef. pr.:	arh. Emil Crisan		1:100	Faza: PTh
Proiectat:	ing.Radu Roman		Data: SEPT 2017	Nr. pl.:
Desenat:	ing.Radu Roman		Amplasament: Rupea, jud. Brasov, str. Republicii nr 147	IDSAI-03
Titlu pt.: INSTALATII ELECTRICE SEMNALIZARE INCENDII PLAN COTA POD				

