


NOTA:
 Traseele cablurilor instalatiei de semnalizare a incendiilor se vor amplasa la distanta de minim 30cm fata de traseele instalatiei electrice de curenti tari.
 La executarea instalatiilor electrice si a instalatiilor de semnalizare a incendiilor se vor respecta prevederile din normativele P118/3-2015 si I7-2011

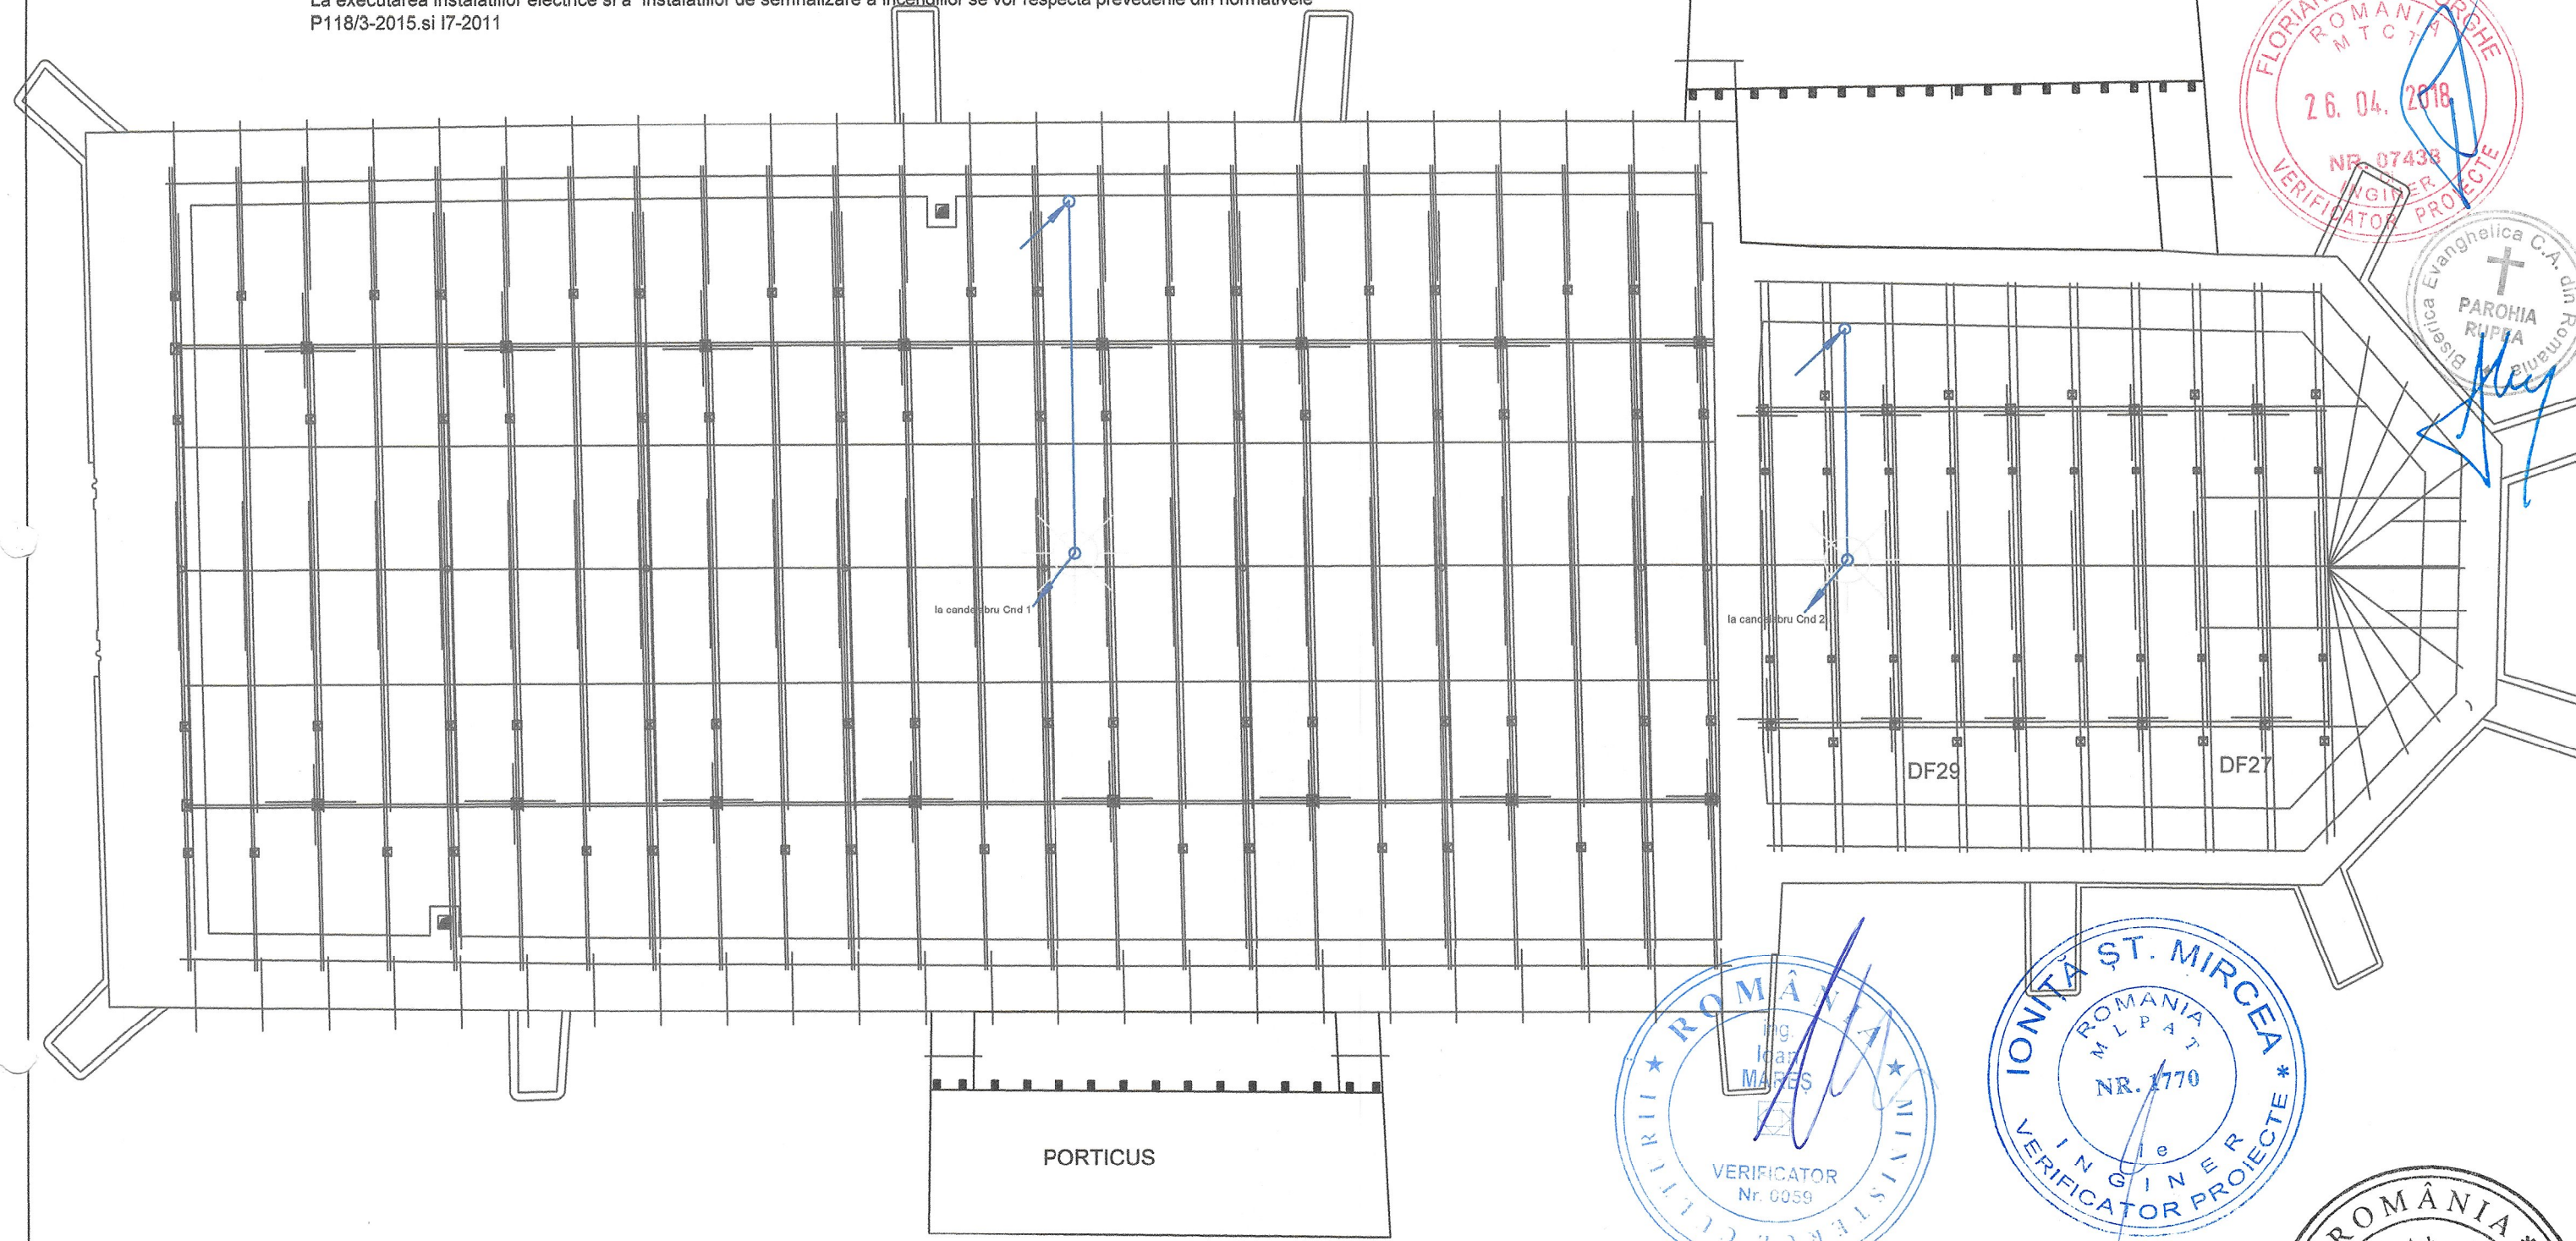

LEGENDA

— Cablu rezistent la foc NHXH 3x1,5 E30/FE180 / in teava de otel zincat 3/4"

PROIECTANT GENERAL/ARHITECTURA: ALEXANDRU IOAN NICHIFOR - BIROU INDIVIDUAL DE ARHITECTURA			
Verificator Expert	NUME:	SEMNATURA:	REFERAT / EXPERTIZA NR./DATA:
PROIECTANT GENERAL: ALEXANDRU IOAN NICHIFOR B.I.A. nr. pr. 03/2017			
S.C. PROCONFORT S.R.L. Brasov str. Zizinului nr. 102 tel/fax: 0268 333311		Beneficiar: PAROHIA EVANGHELICA C.A. RUPEA	
SPECIFICATIE:	NUME:	SEMNATURA:	Scara: 1:100
Sef. pr.:	arh. Emil Crisan		
Proiectat:	ing. Radu Roman	Data: SEPT. 2017	Amplasament: Rupea, jud. Brasov, str. Republicii nr 147
Desenat:	ing. Radu Roman		Titlul pl.: INSTALATII ELECTRICE PLAN POD
			Nr. pr. electrice: 1314/2017 Faza: PTh Nr. pl.: E-03.1

